

MX150 MAT SEAL / UNSEALED BLADE CRIMP TERMINAL

1.0 SCOPE

This specification details the crimping information and common practices of general crimps for the Molex MX150 Mat Seal / Unsealed Blade Terminal. Please refer to sales drawing SD-33000-001 for additional part information. The information in this document is for reference and benchmark purposes only. Customers are required to complete their own validation testing if tooling and/or wire is different than what is shown in this specification.

All measurements are in millimeters and Newtons unless specified otherwise.

Terminals shown in this document are generic representations. They are not intended to be an image of any terminal listed in the scope.

2.0 PRODUCT DESCRIPTION

DEFINITION OF TERMS:

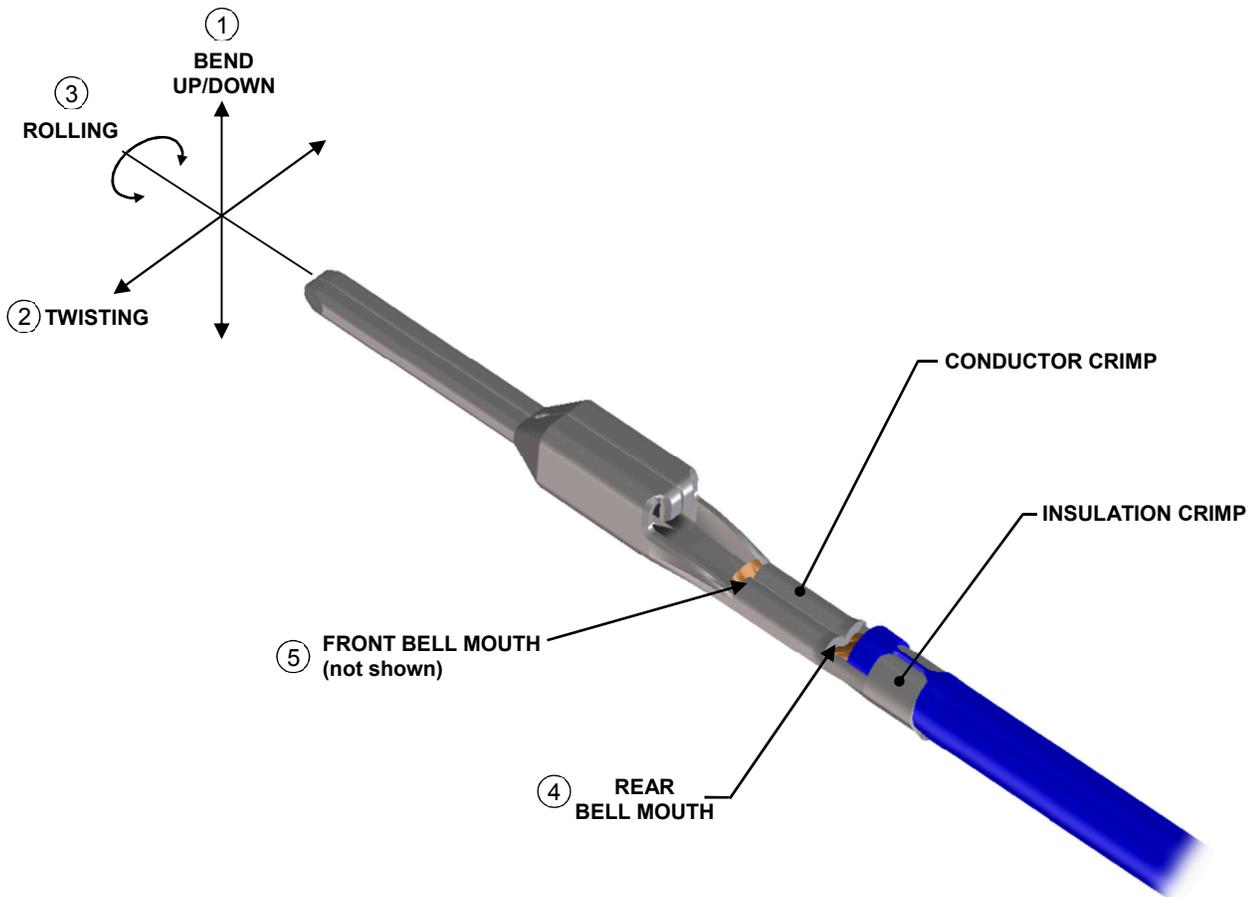


Figure 1

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 1 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

DEFINITIONS OF TERMS (CONT.):

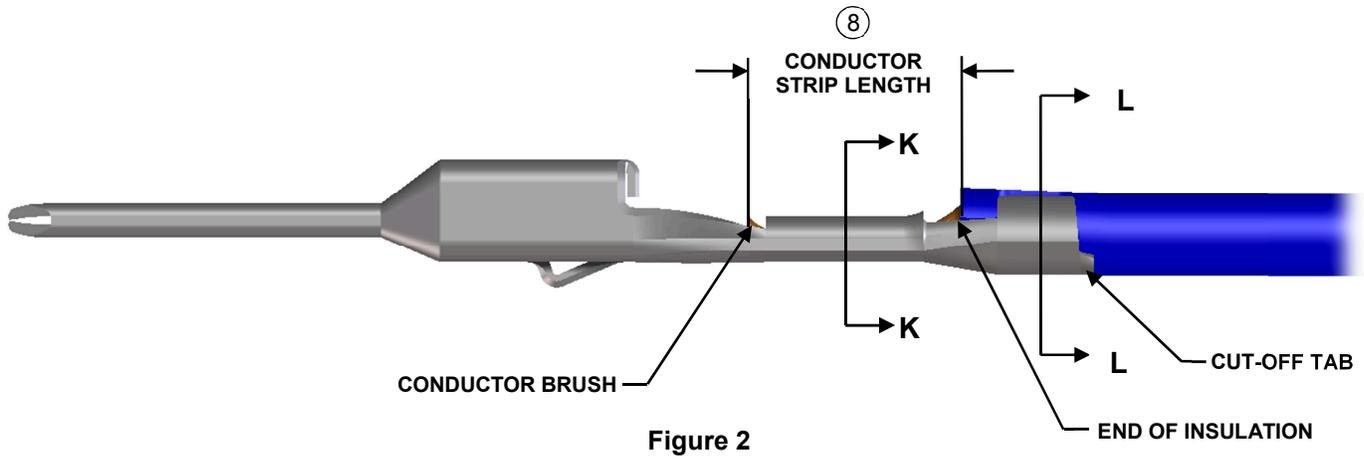


Figure 2

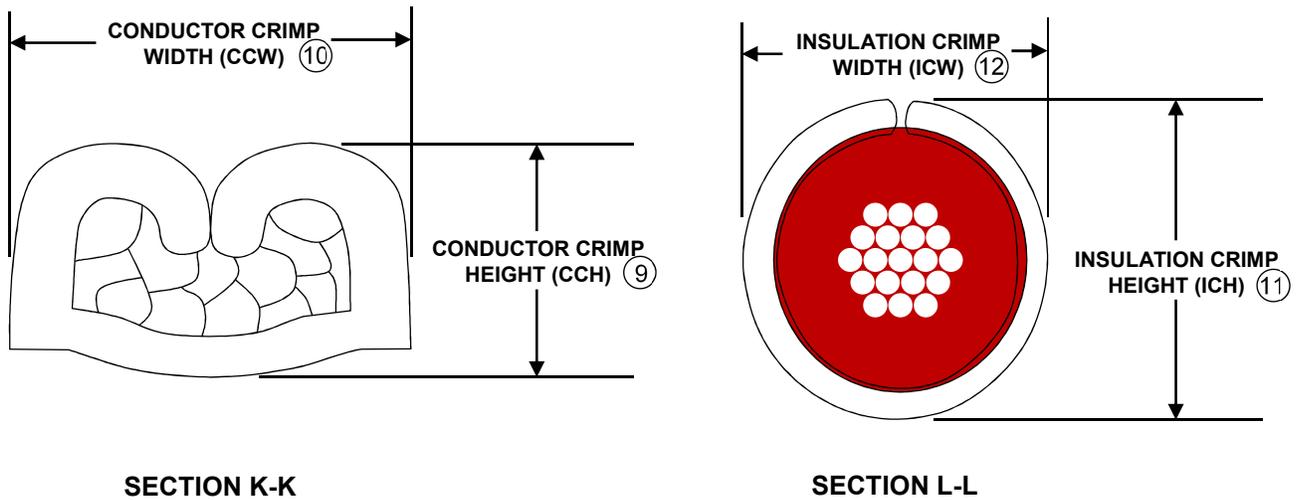


Figure 3

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 2 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

STRAIGHTNESS MEASUREMENTS

The crimping process may result in some bending between the conductor crimp and the terminal box. This bending must not exceed the limits shown in Table 3.

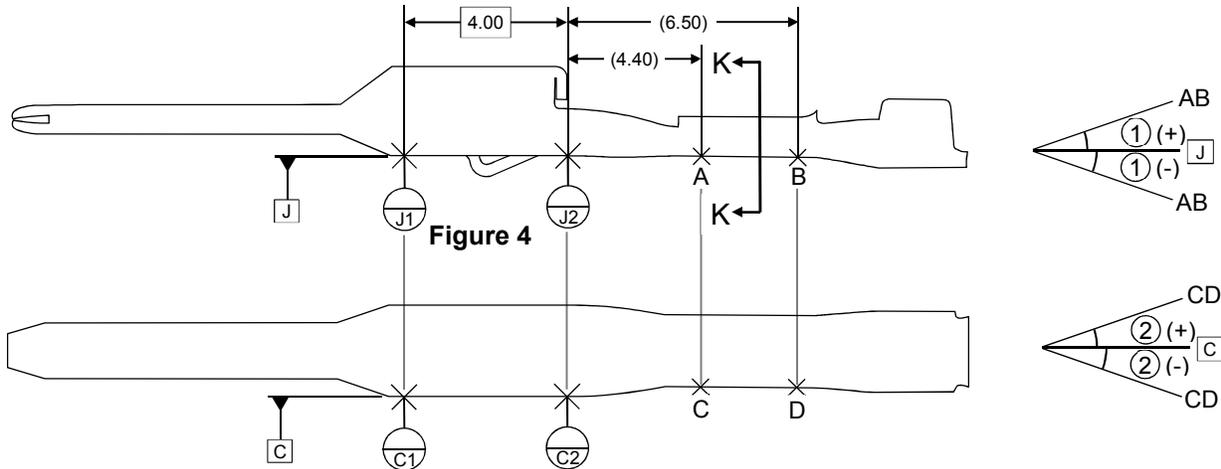


Figure 5

BEND UP/DOWN ①

To measure bend up/down, establish datum J as shown in Figure 4 then measure the angle of the line defined by points A and B with respect to the datum. Positive angles are defined as bend up and negative angles are defined as bend down.

TWISTING ②

To measure twisting, establish datum C as shown in Figure 5, then measure the angle of the line defined by points C and D with respect to the datum.

ROLLING ③

To measure rolling, cross section the part at section K-K (see Figure 4), then clamp the part in a vice as shown in Figure 6. Using a shadowgraph, focus the graph to section H-H and establish line M-M as the top of the terminal box. With line M-M established, refocus the graph to section J-J. Measure the angle of the line defined by points E and F with respect to line M-M.

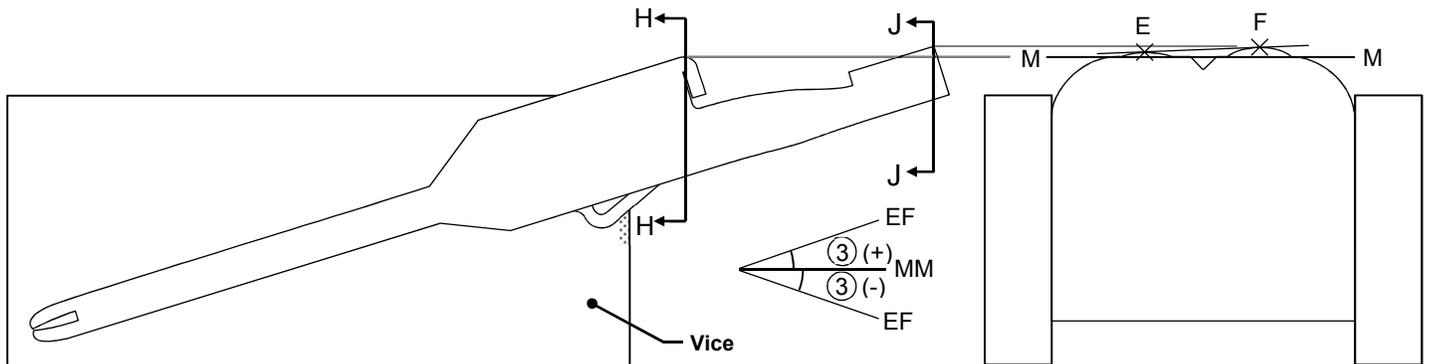


Figure 6

REVISION:	ECR/ECN INFORMATION:	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No.
B2	EC No: UAU2014-1789 DATE: 2014 / 07 / 08			3 of 20
DOCUMENT NUMBER:	CREATED / REVISED BY:	CHECKED BY:	APPROVED BY:	
AS-33000-001	B.Jennings	A.Dhir	B.Moser	

BELLMOUTH (FLARE) ④⑤

The flare that is formed on the edge of the conductor crimp acts as a funnel for the wire strands. This funnel reduces the possibility that a sharp edge on the conductor crimp will cut or nick the wire strands. A rear bellmouth is required on the conductor crimp. A front bellmouth is optional. Caution: Excessively large bellmouths will reduce crimp area and reduce pull forces. See Table 3 for bellmouth specifications.

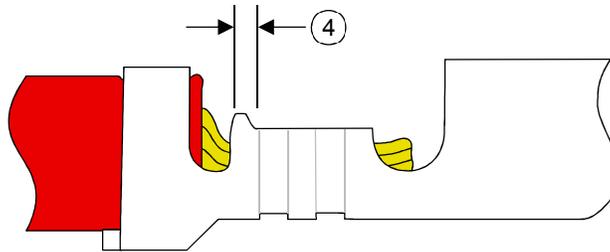


Figure 7

CUT-OFF TAB ⑥

This is the material that protrudes outside the insulation crimp after the terminal is separated from the carrier strip. A cut-off tab that is too long may expose a terminal outside the housing and it may fail electrical spacing requirements. In most situations, a tool is setup to provide a cut-off tab that shall not exceed the value indicated in Table 3. CAUTION: Burrs on the cut-off tab are not allowed as they have the potential to cut mat seals.

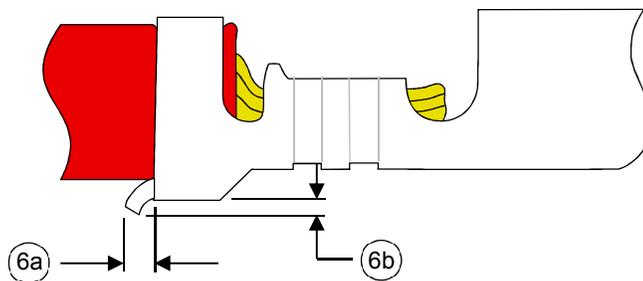


Figure 8

CONDUCTOR BRUSH ⑦

The conductor brush is made up of the wire strands that extend past the conductor crimp on the contact side of the terminal. This helps ensure that mechanical compression occurs over the full length of the conductor crimp. The conductor brush should not extend into the contact area or above the conductor crimp/transition wall height (whichever is tallest), see Figure 9 and Table 3. CAUTION: Excessive conductor brush extended above the transition/crimp area can cause terminal retention issues inside plastic cavity and potentially could compromise/tear the glands of the mat seal.

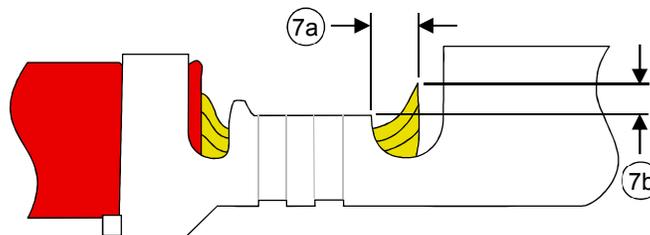


Figure 9

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 4 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser	

CONDUCTOR STRIP LENGTH ⑧

The strip length is determined by measuring the exposed conductor strands after the insulation is removed. The strip length determines the conductor brush length when the end-of-insulation position is centered in the transition area between conductor and insulation crimps. See Table 3 for the length requirement

CAUTION: Care must be taken to ensure that all conductor strands are equal in length (no diagonally cut strands). No scratched or missing strands are permitted. The insulation cut must be uniform (no diagonally cut insulation and no extrusions of insulation). Care must also be taken not to leave indentations on the wire strands during the strip and cut operation as this can compromise the effectiveness of the mat seal and can result in leaks.

CONDUCTOR CRIMP

This is the metallurgical compression of a terminal around the wire's conductor. This connection creates a common electrical path with low resistance and high current carrying capabilities. The crimp seam shall not be open and all conductor strands must be contained within the conductor crimp.

CONDUCTOR CRIMP HEIGHT ⑨

The conductor crimp height is measured from the top surface of the formed crimp to the bottom most radial surface. Do not include the extrusion points in this measurement. Measuring crimp height is a quick, non-destructive way to help ensure the correct metallurgical compression of a terminal around the wire's conductor and is an excellent attribute for process control. The crimp height specification is typically set as a balance between electrical and mechanical performance over the complete range of wire stranding and coatings, and terminal materials and plating. Although it is possible to optimize a crimp height to individual wire strands and terminal plating, one crimp height specification is normally created. See Table 2 for crimp height specifications.

INSULATION CRIMP HEIGHT ⑪

Insulation crimp heights are specified in Table 2. MX150 Mat Seal / Unsealed Blade Terminals are designed to accommodate multiple wire sizes. Although within the terminal range, an insulation grip may not completely surround the wire, an acceptable insulation crimp will still be provided. The insulation crimp should be visually evaluated to confirm it provides adequate compression on the wire. It should also be evaluated by sectioning through the center of the crimped insulation grip. The grip should compress the insulation but not pierce it or otherwise damage the integrity of the insulation. The grip should not contact the conductors under any circumstance.

Once the optimum setting for an insulation crimp height is determined, it is important to document it. The operator can then check it as part of the setup procedure.

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 5 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

EXTRUSIONS (ANVIL FLASH / BURR) ⑬

These are the small flares that form on the bottom of the conductor crimp resulting from the clearance between the punch and anvil tooling. If the anvil is worn or the terminal is over-crimped, excessive extrusion can result.

An uneven extrusion may also result if the punch and anvil are misaligned, if the feed is misadjusted or if there is insufficient or excessive terminal drag. CAUTION: Anvil Flash has the potential to damage mat seals and should be maintained within specifications (see Figure 10 and Table 3). Note: Anvil Flash (Burr) may not extend below the bottom of the crimp.

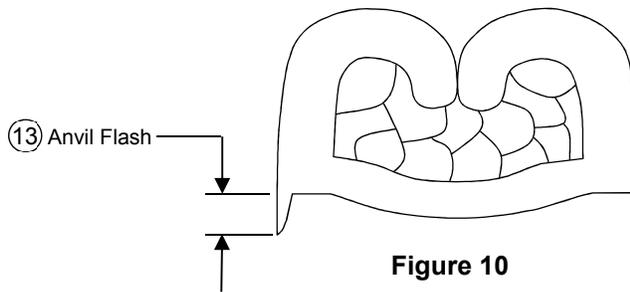


Figure 10

INSULATION GRIP STEP ⑭

The insulation grip step is the designed offset between the conductor grip and the insulation grip which must be met by the crimp process (see Figure 11 and Table 3). To measure the grip step, establish datum J as shown in Figure 11, and then measure the grip step as the from the lowest point of the insulation grip, excluding the cutoff tab and wire insulation.

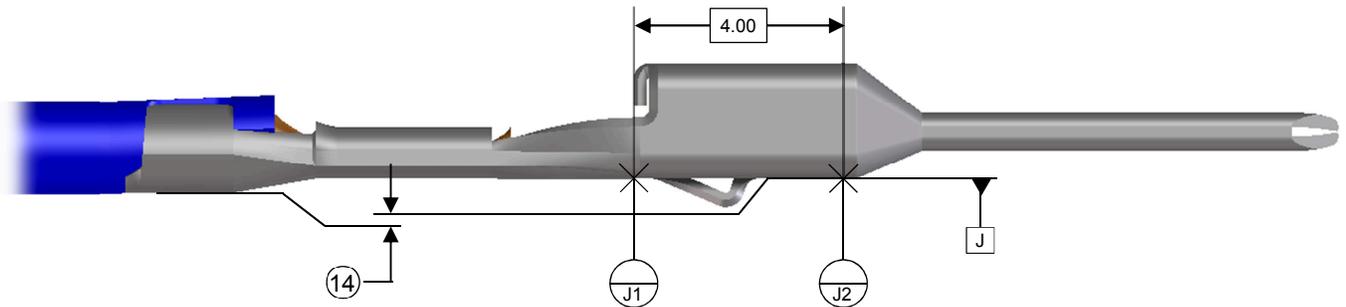


Figure 11

END-OF-INSULATION POSITION

This is the location of the insulation in relation to the transition area between the conductor and insulation crimps. Equal amounts of the conductor strands and insulation needs to be visible in the transition area. The end-of insulation position ensures that the insulation is crimped along the full length of the insulation crimp and that no insulation gets crimped under the conductor crimp. The end-of-insulation position is set by the wire stop and strip length for bench applications. For automatic wire processing applications the end-of-insulation position is set by the in/out press adjustment (see Figure 2).

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 6 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

CRIMP BULGE (15)

Caution needs to be taken with the crimp tooling to prevent a bulge in the transition area during crimping. The transition should generally flow smoothly from the conductor crimp to the terminal box. Any bulge must not exceed the width shown in Table 3. See Figure 12 for an example of crimp bulge.

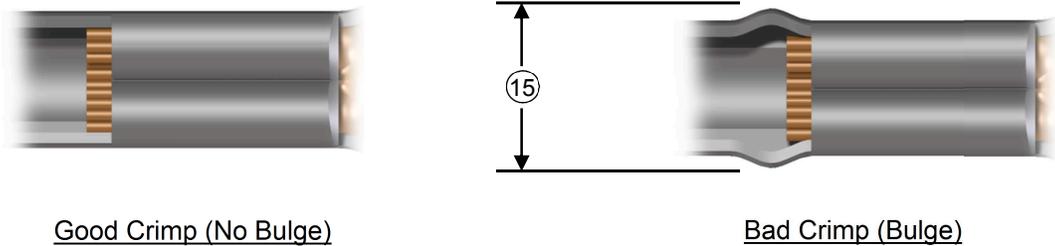


Figure 12

BLADE DEFORMATION

Care must be taken to ensure that the terminal box and blade section are not deformed during crimping and handling. Any deformation of the blade position relative to the terminal box must not exceed the tolerances specified in sales drawing SD-33000-001.

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 7 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

3.0 PRODUCT SPECIFICATIONS

Table 1

Terminal Family	Gender	Sealing	Plating	Special Characteristics	Grip Code	Wire Size	Insulation Diameter Range	
MX150	Blade	Mat Seal / Unsealed	Sn	Standard Performance Tin	M3	0.35 – 0.50mm ²	1.20 – 1.70	
				High Performance Tin				
			Ag	High Performance Silver				
			Au	High Performance Gold				
			Sn	High Performance Tin	22	22AWG	1.50 – 1.65	
				Ag				High Performance Silver
				Au				High Performance Gold
			Sn	High Performance Tin	18	20 – 16AWG 0.75 – 1.00mm ²	1.60 – 2.54	
				Ag				High Performance Silver
				Au				High Performance Gold
			Sn	High Performance Tin	14	14AWG 1.50 – 2.00mm ²	2.10 – 2.70	
				Ag				High Performance Silver
Au	High Performance Gold							

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 8 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

Table 2

Molex Product Attribute			Validated Wire		Conductor Barrel		Insulation Barrel		MIN PULL OUT FORCE
Grip Code	Special Characteristics	Sealing	Wire Type	Wire Size	CCH ±0.05	CCW ±0.10	ICH ±0.10	ICW ±0.10	
M3	Standard Performance Tin High Performance Tin High Performance Silver High Performance Gold	Mat Seal / Unsealed	T3ZHID	0.35mm ²	1.05 ±0.03	1.60	1.75	2.00	50
			T3ZHID	0.50mm ²	1.10		1.90		75
22	High Performance Tin High Performance Silver High Performance Gold		M1L-123A4 (TXL)	22AWG	1.00	1.60	1.85	1.90	50
18	High Performance Tin High Performance Silver High Performance Gold		M1L-123A4 (TXL)	20AWG	1.15	2.15	1.90	2.10	75
			SAE J1128 (GXL)	20AWG	1.15		2.00	2.30	75
			M1L-123A4 (TXL)	18AWG	1.25		2.00	2.30	90
			SAE J1128 (GXL)	18AWG	1.25		2.30	2.60	90
			M1-123A4 (TXL)	16AWG	1.35		2.20	2.60	120
			M1L-126A1	0.75mm ²	1.25		1.95	2.30	90
			M1L-126A1	1.00mm ²	1.30		2.00	2.30	120
14	High Performance Tin High Performance Silver High Performance Gold		M1L-123A4 (TXL)	14AWG	1.65	2.45	2.85	2.75	180
			M1L-135A1 (UTX)	14AWG	1.65		2.80	2.80	180
			M1L-126A1	1.50mm ²	1.40		2.65	2.80	150
			JASO D611 (AVSS)	2.00mm ²	1.60		2.85	2.75	180

The above specifications are guidelines to an optimum crimp. Crimp heights/widths are applicable for punch/anvil tooling shown in Figures 15 - 19.

Pull force should be measured with no influence from the insulation crimp.

Customers are required to complete their own validation testing if tooling and/or wire is different than what is shown in this specification.

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 9 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

Table 3

Specifications

Balloon #	Feature	Requirement	
1	Bend Up/Down	TYP.	± 3° MAX
		Grip Code M3	± 1.5° MAX
2	Twisting	± 3° MAX	
3	Rolling	± 3° MAX	
4	Rear Bell Mouth	0.30 – 0.70	
5	Front Bell Mouth	Not Applicable	
6	Cut-Off Tab	a	0.50 MAX
		b	No Burr
7	Conductor Brush	a	0.40 MAX
		b	Not to extend above conductor crimp/transition height
8	Conductor Strip Length	4.70 – 5.60 for reference	
9	Conductor Crimp Height	See Table 2	
10	Conductor Crimp Width	See Table 2	
11	Insulation Crimp Height	See Table 2	
12	Insulation Crimp Width	See Table 2	
13	Conductor Anvil Flash	0.1 MAX	
14	Insulation Grip Step From J1-J2 (see Figure 11)	TYP.	0.30 ± 0.10
		Grip Code M3	0.15 ± 0.30
15	Crimp Bulge	2.62 MAX	

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 10 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

4.0 REFERENCE DOCUMENTS

Reference documentation for general practices is located on the website per the below links:

1. Molex Quality Crimping Handbook http://www.molex.com/images/products/apptool/qual_crimp.pdf
2. Molex-Recognizing Good Crimps <http://www.molex.com>, search for Application Tooling

5.0 PROCEDURE

5.1 GENERAL MEASUREMENT AND EVALUATION REQUIREMENTS

Crimp Height Measurement (Anvil Flash Evaluation)

1. Complete tool set-up procedure.
2. Crimp a minimum of 5 samples.
3. Place the flat blade of the crimp micrometer across the center of the dual radii of the conductor crimp. Do not take the measurement near the conductor bell mouth (see Figure 13).
4. Rotate the micrometer dial until the point contacts the bottom most radial surface. If using a caliper, be certain not to measure the conductor anvil flash (extrusions) of the crimp (see Figure 14).

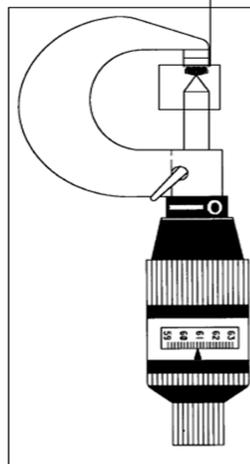



Figure 13

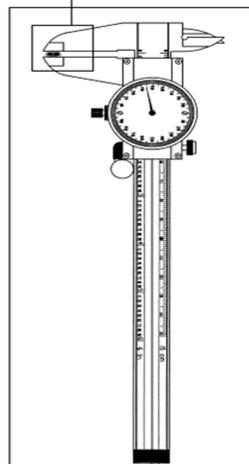




Figure 14

6.0 CRIMP TOOLING GEOMETRY

The crimp tooling information shown below defines the tooling used by Molex to perform validation testing to establish recommended crimp height and widths. The user is responsible for validating crimp performance based on tooling, equipment and wire that is being used.

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 11 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser	

Conductor Tool Geometry Variant A

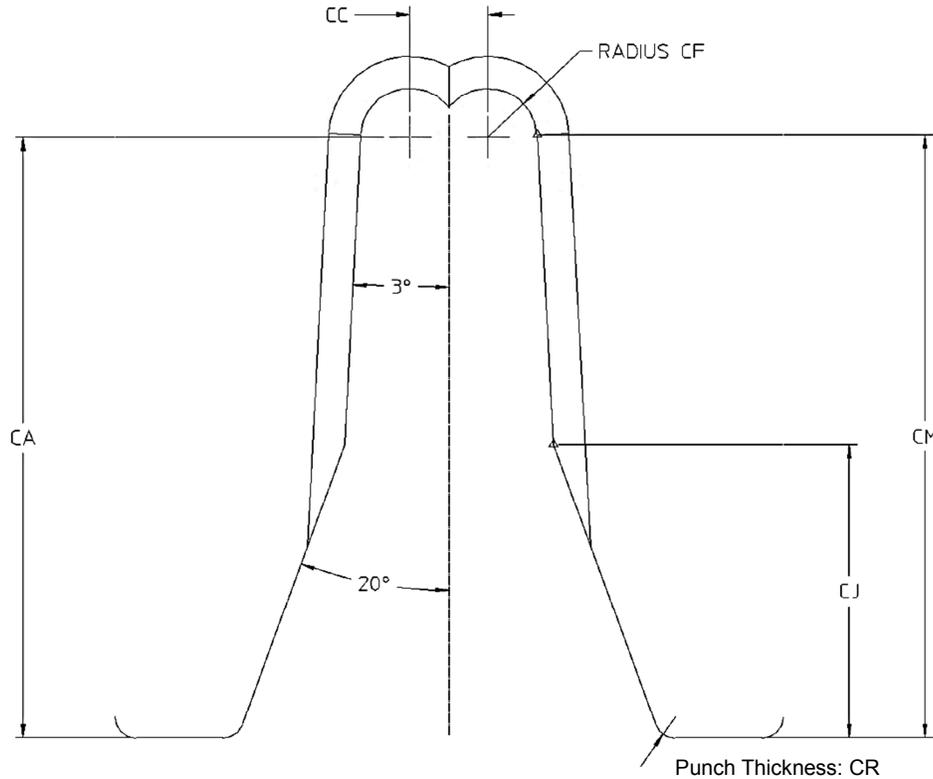

Applicable Terminals			
Grip Code	Wire Sizes		Conductor Variant A
	SAE	Metric	
M3	N/A	0.35-0.50	
22	22	N/A	X
18	20	0.75	X
	20 (GXL)	N/A	X
	18	1.00	X
	18 (GXL)	N/A	X
16	1.50		
14	14	2.00	


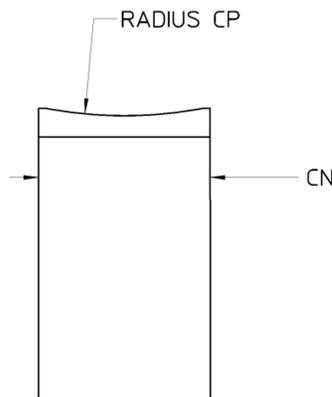


Figure 15
Conductor Tool Geometry - Variant A


GENERAL TOLERANCE UNLESS OTHERWISE SPECIFIED		
DEC. PLCS.	MM	INCH
4 PLACES	± ---	± ---
3 PLACES	± ---	± ---
2 PLACES	± 0.13	± ---
1 PLACE	± 0.25	± ---
ANGULAR	± 0.5°	

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 12 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

Conductor Tool Geometry Variant B

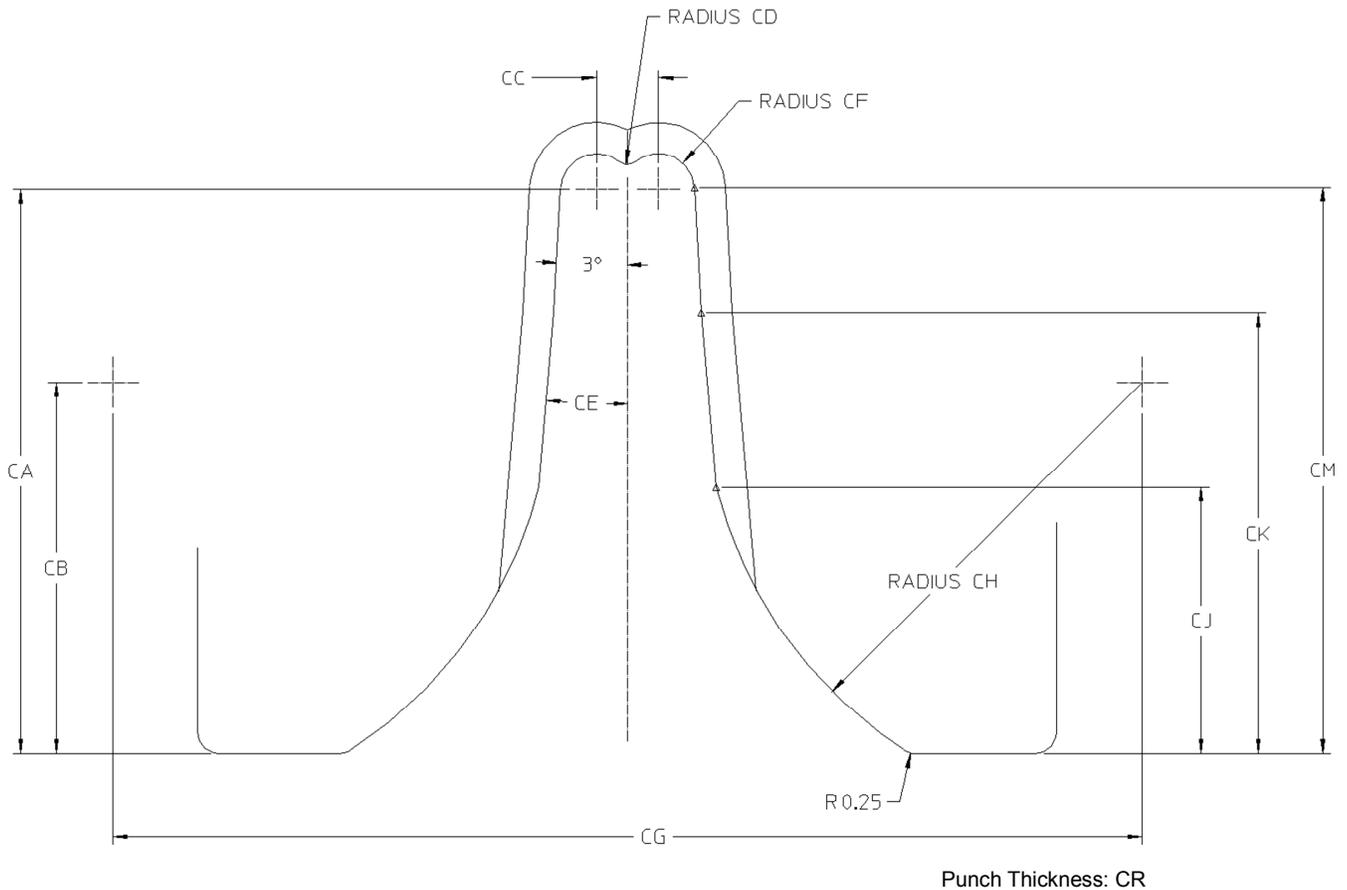

Punch Thickness: CR

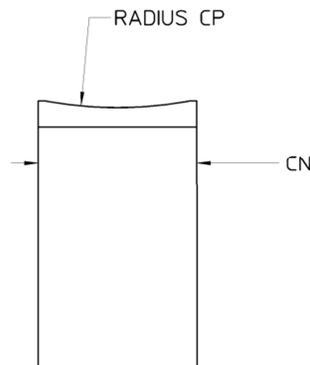


Applicable Terminals			
Grip Code	Wire Sizes		Conductor Variant B
	SAE	Metric	
M3	N/A	0.35-0.50	X
22	22	N/A	
18	20	0.75	
	20 (GXL)	N/A	
	18	1.00	
	18 (GXL)	N/A	
16	1.50		
14	14	2.00	

Figure 16
Conductor Tool Geometry – Variant B

GENERAL TOLERANCE UNLESS OTHERWISE SPECIFIED		
DEC. PLCS.	mm	INCH
4 PLACES	± ---	± ---
3 PLACES	± ---	± ---
2 PLACES	± 0.13	± ---
1 PLACE	± 0.25	± ---
ANGULAR	± 0.5°	

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 13 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings		CHECKED BY: A.Dhir

Conductor Tool Geometry Variant C

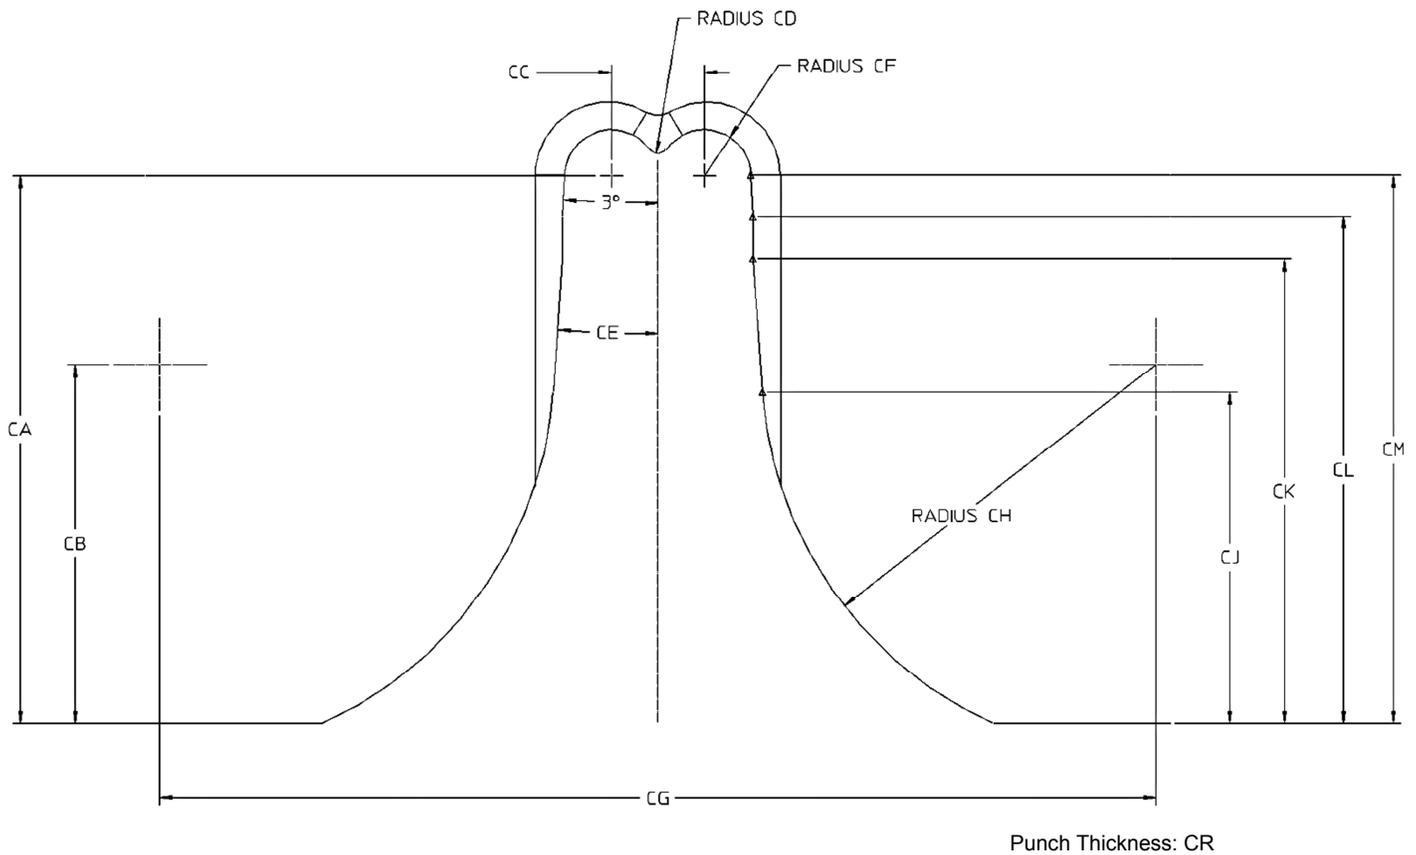

Applicable Terminals			
Grip Code	Wire Sizes		Conductor Variant C
	SAE	Metric	
M3	N/A	0.35-0.50	
22	22	N/A	
18	20	0.75	
	20 (GXL)	N/A	
	18	1.00	
	18 (GXL)	N/A	
	16	1.50	X
14	14	1.50 - 2.00	X


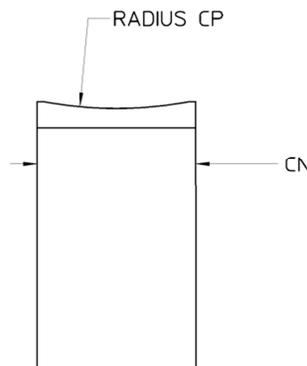


Figure 17
Conductor Tool Geometry - Variant C


GENERAL TOLERANCE UNLESS OTHERWISE SPECIFIED		
DEC. PLCS.	mm	INCH
4 PLACES	± ---	± ---
3 PLACES	± ---	± ---
2 PLACES	± 0.13	± ---
1 PLACE	± 0.25	± ---
ANGULAR	± 0.5°	

REVISION:	ECR/ECN INFORMATION:	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No.
B2	EC No: UAU2014-1789 DATE: 2014 / 07 / 08		14 of 20
DOCUMENT NUMBER:	CREATED / REVISED BY:	CHECKED BY:	APPROVED BY:
AS-33000-001	B.Jennings	A.Dhir	B.Moser

Insulation Tool Geometry Variant A

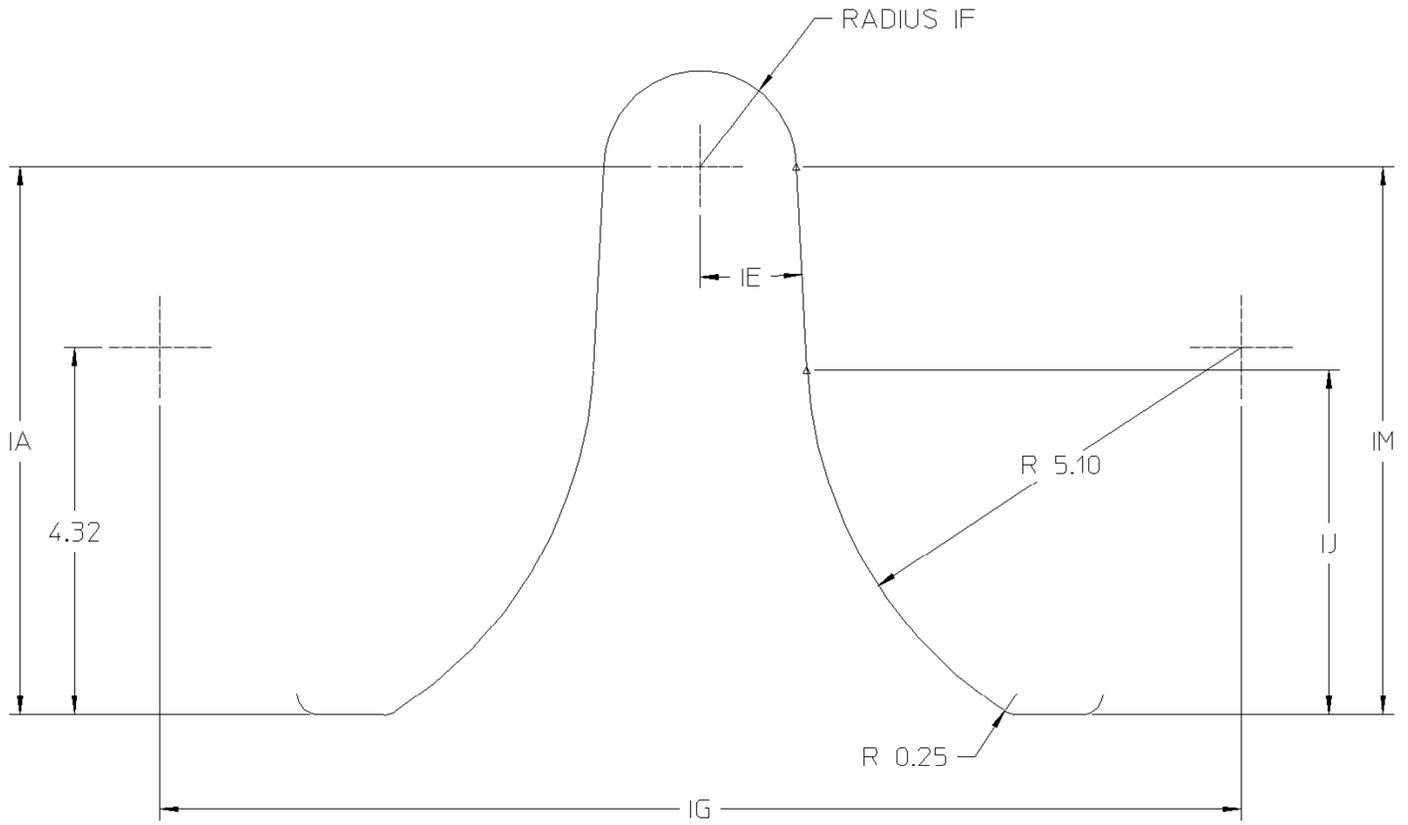

Punch Thickness: IR

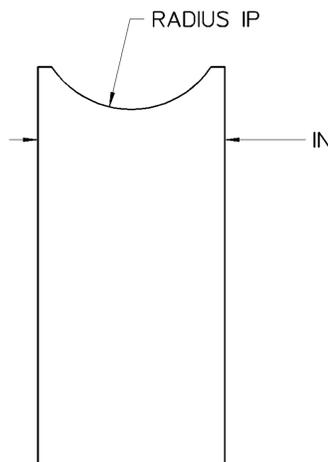



Applicable Terminals			
Grip Code	Wire Sizes		Insulation Variant A
	SAE	Metric	
M3	N/A	0.35-0.50	X
22	22	N/A	X
18	20	0.75	X
	20 (GXL)	N/A	X
	18	1.00	X
	18 (GXL)	N/A	
14	14	1.50 - 2.00	

Figure 18
Insulation Tool Geometry – Variant A

GENERAL TOLERANCE UNLESS OTHERWISE SPECIFIED		
DEC. PLCS.	mm	INCH
4 PLACES	± ---	± ---
3 PLACES	± ---	± ---
2 PLACES	± 0.13	± ---
1 PLACE	± 0.25	± ---
ANGULAR	± 1/2°	

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 15 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings		CHECKED BY: A.Dhir

Insulation Tool Geometry Variant B

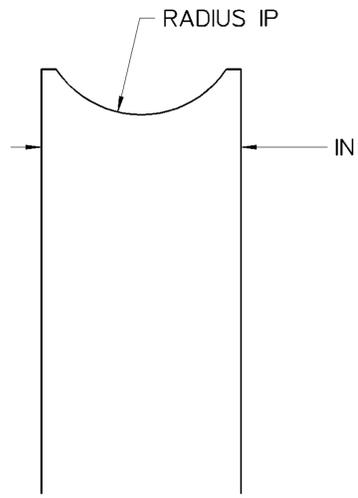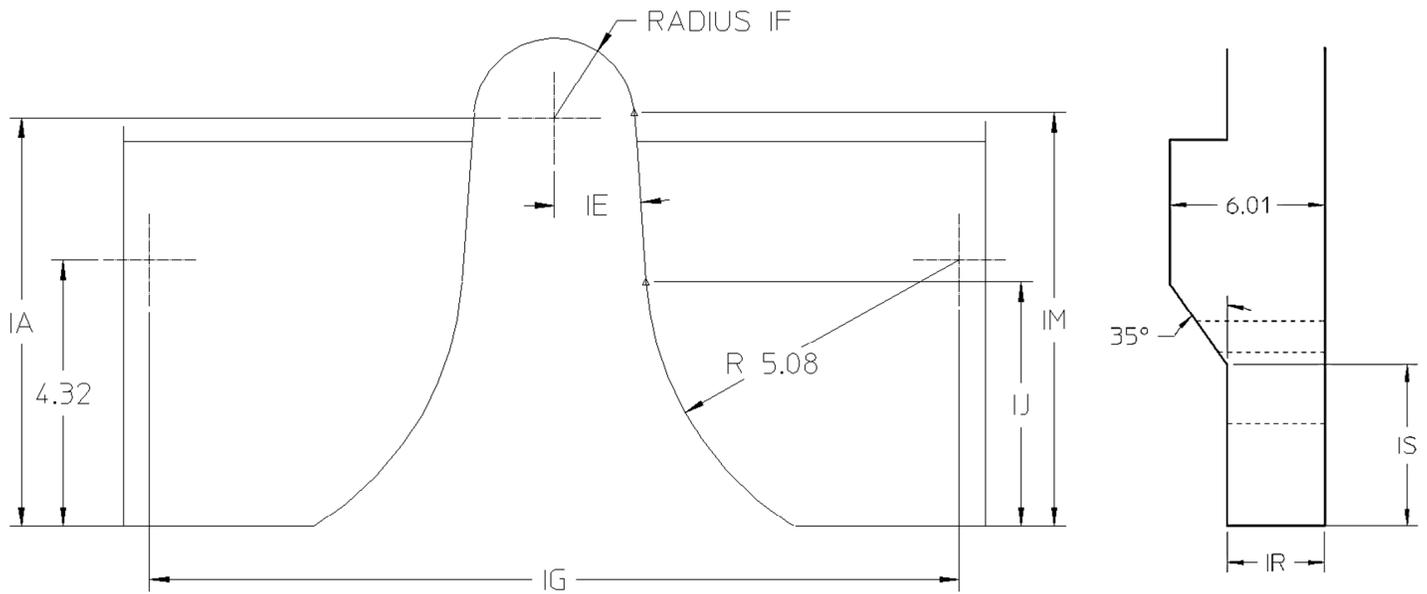

Applicable Terminals			
Grip Code	Wire Sizes		Insulation Variant B
	SAE	Metric	
M3	N/A	0.35-0.50	
22	22	N/A	
18	20	0.75	
	20 (GXL)	N/A	
	18	1.00	
	18 (GXL)	N/A	X
	16	1.50	X
14	14	1.50 - 2.00	X

GENERAL TOLERANCE UNLESS OTHERWISE SPECIFIED		
DEC. PLCS.	MM	INCH
4 PLACES	± ---	± ---
3 PLACES	± ---	± ---
2 PLACES	± 0.13	± ---
1 PLACE	± 0.25	± ---
ANGULAR	± 1/2°	

Figure 19
Insulation Tool Geometry – Variant B

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION	SHEET No. 16 of 20
DOCUMENT NUMBER: AS-33000-001	CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

Table 4 – Conductor Tooling Dimensions

See Figures 15 – 19 for geometry

Grip Code	Wire Sizes		See Fig. #	Punch														Anvil	
	SAE [AWG]	Metric [mm ²]		CA	CB	CC	CD	CE	CF	CG	CH	CJ	CK	CL	CM	CR	CN	CP	
M3	N/A	0.35-0.50	13	6.57	4.32	0.72	0.13	5°	0.42	11.97	5.10	3.10	5.13	-	6.59	4.45	1.61	1.44	
22	22	N/A	12	7.33	-	0.65	-	-	0.43	-	-	4.55	-	-	7.35	3.95	1.50	0.94	
18	20	0.75	12	7.16	-	0.93	-	-	0.59	-	-	3.50	-	-	7.19	3.95	2.06	1.31	
	20 (GXL)	N/A	12	7.16	-	0.93	-	-	0.59	-	-	3.50	-	-	7.19	3.95	2.06	1.31	
	18	1.00	12	7.16	-	0.93	-	-	0.59	-	-	3.50	-	-	7.19	3.95	2.06	1.31	
	18 (GXL)	N/A	12	7.16	-	0.93	-	-	0.59	-	-	3.50	-	-	7.19	3.95	2.06	1.31	
	16	1.50	14	6.52	4.32	0.99	0.13	4°	0.57	12.46	5.08	3.96	5.19	6.30	6.55	4.00	2.139	1.935	
14	14	1.50-2.00	14	7.05	4.63	1.19	0.12	4°	0.60	12.82	5.08	4.27	5.9	6.54	7.06	6.55	2.438	6.110	

Except GXL wire

REVISION:

ECR/ECN INFORMATION:

B2

EC No: UAU2014-1789

DATE: 2014 / 07 / 08

SHEET No.

17 of 20

MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION

DOCUMENT NUMBER:

AS-33000-001

CREATED / REVISED BY:

B.Jennings

CHECKED BY:

A.Dhir

APPROVED BY:

B.Moser

Table 5 – Insulator Tooling Dimensions

See Figures 15 – 19 for geometry

Grip Code	Wire Sizes		Punch									Anvil	
	SAE	Metric	See Fig. #	IA	IE	IF	IG	IJ	IM	IR	IS	IN	IP
M3	N/A	0.35–0.50	15	6.31	3°	1.00	12.29	3.22	6.36	3.75	-	1.98	0.95
22	22	N/A	15	6.31	3°	0.93	12.29	4.05	6.36	2.70	-	1.84	0.95
18	20	0.75	15	6.36	3°	1.03	12.49	4.05	6.41	3.95	-	2.04	1.05
	20 (GXL)	N/A	15	6.45	3°	1.13	12.70	4.05	6.45	3.95	-	2.23	1.15
	18	1.00	15	6.45	3°	1.13	12.70	4.05	6.45	3.95	-	2.23	1.15
	18 (GXL)	N/A	16	6.50	3°	1.28	12.96	4.05	6.57	3.80	6.57	2.525	1.300
	16	1.50	16	6.50	3°	1.28	12.96	4.05	6.57	3.80	6.57	2.525	1.300
14	14	1.50–2.00	16	6.63	4°	1.30	13.12	3.97	6.72	3.80	6.25	2.722	1.400

Except GXL wire

REVISION:

B2

ECR/ECN INFORMATION:

EC No: UAU2014-1789

DATE: 2014 / 07 / 08

DOCUMENT NUMBER:

AS-33000-001

SHEET No.

MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION

18 of 20

CREATED / REVISED BY:

B.Jennings

CHECKED BY:

A.Dhir

APPROVED BY:

B.Moser

7.0 CRIMP STRAIGHTNESS

A sample method for maintaining crimp straightness is shown in Figure 20 below.

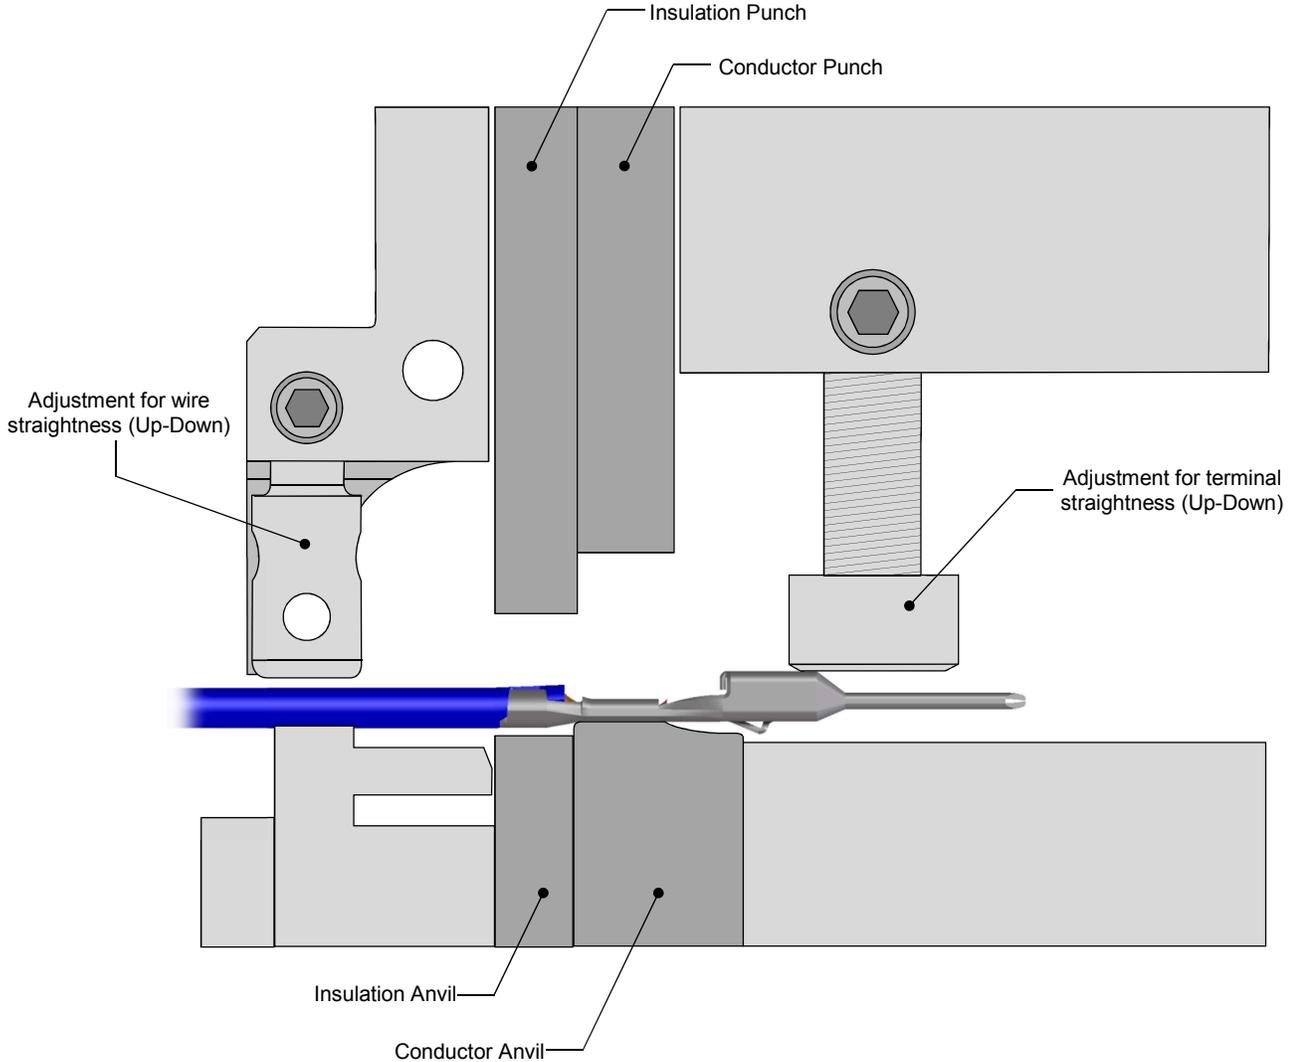


Figure 20

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 19 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser

8.0 APPLICATION TOOLING

Application Tooling for the MX150 Blade Terminals can be obtained directly from Molex.

To find the proper and latest Molex Application Tooling

1. Go to <http://www.molex.com>
2. Enter the terminal / connector part number into the search box and select the "Go" button.
 - a. Molex part numbers can also be found by searching on the product description.
3. Review the Application Tooling available on the right side of the product window.
 - a. It may be necessary to scroll down on the right side of the terminal / connector product page to view all the tooling options.
 - b. Hand tools and manual type tools require the loose terminal / connector part number to be used in the search.
 - c. Applicator or semi-automatic type tools require the reeled terminal / connector part number to be used in the search.
4. Select the tool part number link
5. Review the tooling page for general tool information
6. Open the link for the Application Tooling Specification (ATS) (located on the left under *Specifications & Other Documents*) for additional details such as:
 - a. Termination specifications: crimp height, pull force, wire strip length, insulation diameter, etc.
 - b. Tool information: tool diagram, tool parts list, repair parts, perishable parts list.
7. Order Molex Application Tooling through your preferred distributor

Notes:

1. Hand crimp tooling can only be used with certain wires and terminal part numbers. Check the Application Tooling Specification Sheet on the Molex website for details.
2. Application Tooling product numbers are subject to change without prior notice. Customers are advised to check the Molex website for the most up-to-date information.
3. Molex FineAdjust™ and MiniMac™ Application Tooling requires the use of left payoff ("D" Wind) parts.

REVISION: B2	ECR/ECN INFORMATION: EC No: UAU2014-1789 DATE: 2014 / 07 / 08	MX150 MAT SEAL / UNSEALED BLADE APPLICATION SPECIFICATION		SHEET No. 20 of 20
DOCUMENT NUMBER: AS-33000-001		CREATED / REVISED BY: B.Jennings	CHECKED BY: A.Dhir	APPROVED BY: B.Moser